


Sample

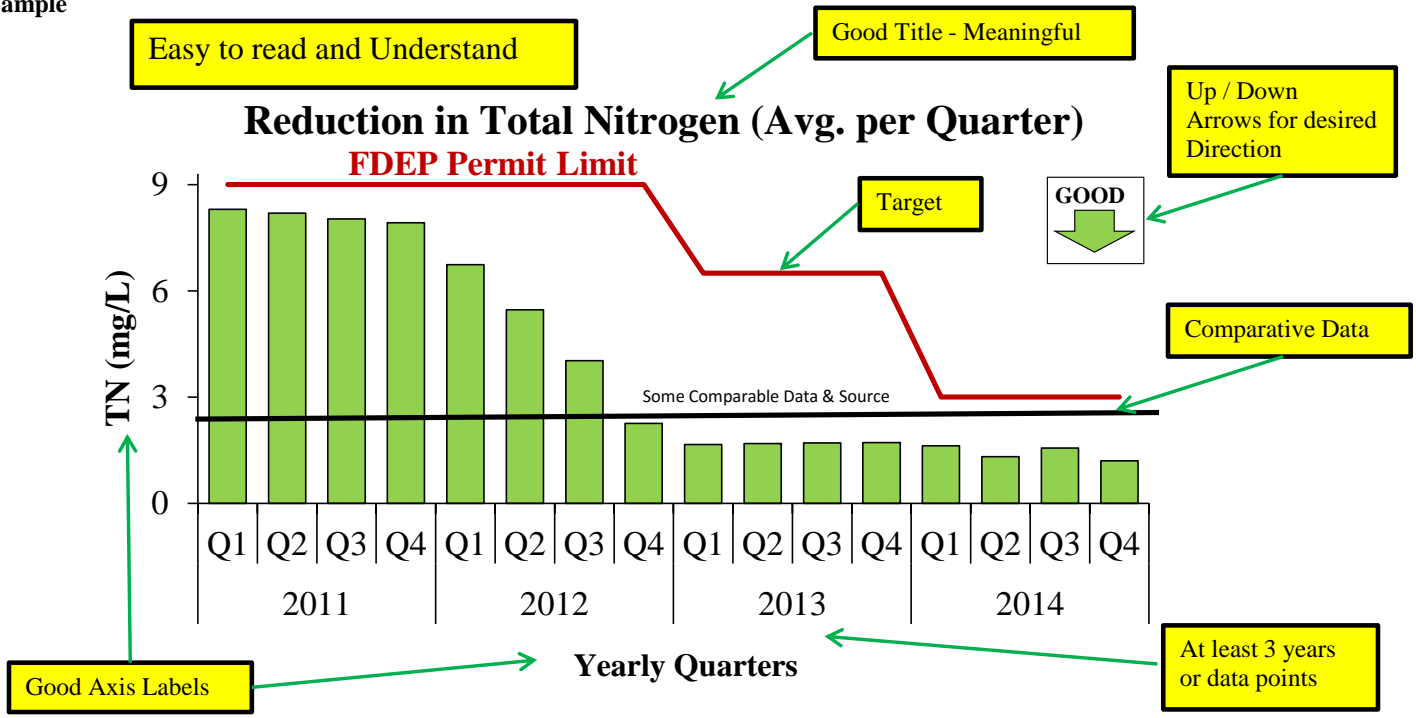

2009	Q1	9.54	12
	Q2	9.14	12
	Q3	8.96	12
	Q4	8.47	12
2010	Q1	8.00	12
	Q2	7.75	12
	Q3	7.93	12
	Q4	8.20	12
2011	Q1	8.30	9
	Q2	8.19	9
	Q3	8.03	9
	Q4	7.92	9
2012	Q1	6.74	9
	Q2	5.46	9
	Q3	4.03	9
	Q4	2.26	9
2013	Q1	1.66	6.5
	Q2	1.69	6.5
	Q3	1.70	6.5
	Q4	1.71	6.5
2014	Q1	1.63	3
	Q2	1.32	3
	Q3	1.57	3
	Q4	1.20	3

7.1a-1 Reduction in Total Nitrogen (AWT Project). This indicator provides a measure of the wastewater treatment plant's effluent quality compliance and the effectiveness of the facility to meet the advanced wastewater treatment standards for total nitrogen. This indicator allows us to demonstrate our commitment to protect our local water resources. The FDEP permit contains multiple nitrogen levels and compliance dates that are to be met through a five-year period. UU has been able to maintain a lower nitrogen value than the limit required.